


# WIRING INSTRUCTIONS

## SSB1001 SERIES MODULAR SWITCH Box

1. Strip outer jacket of cable back  $1\frac{1}{4}$  in. and remove all of the shielding.
2. Separate the internal wires from the shield and twist the shield drain wire.
3. Strip red and black insulation back  $\frac{1}{4}$  in.

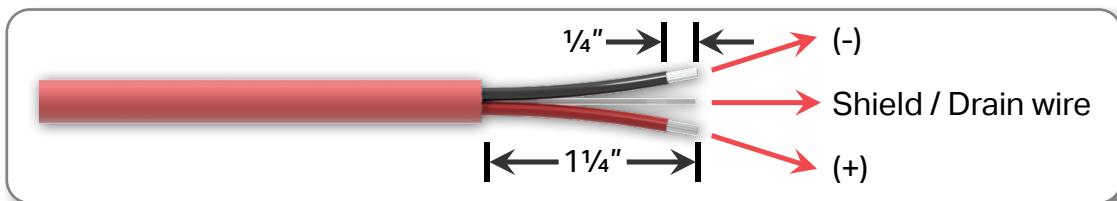

4. Locate the appropriate plug, identified by channel number, remove the plug and install the wires using a small flathead screwdriver. Push plug back into location.

### Orientation is as follows:


- a. Red insulated conductor wire is connected to (+).
- b. Black insulated conductor wire is connected to (-).
- c. Shield drain wire is connected to ground (GND).
- d. Depress selected position button on input terminal block to open terminal for respective wire  
(May need mini flat head screwdriver).



[Visit our website](#) to download the full manual for SSB1001 enclosures.

# WIRING INSTRUCTIONS

## SSB1001 SERIES MODULAR SWITCH BOX

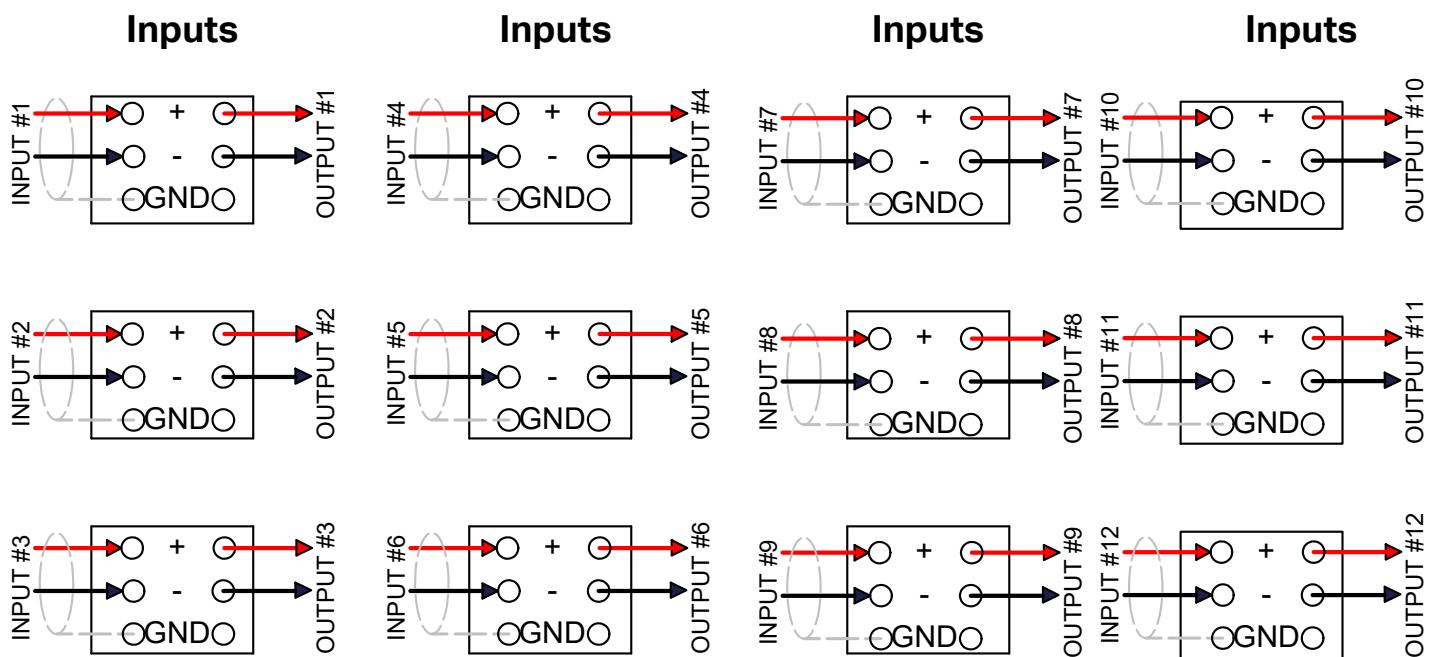

### Sensor Inputs

Red = Signal/Power (+)  
 Black = Common (-)  
 Grey = Shield (Ground)

### Sensor Outputs

Red = Signal/Power (+)  
 Black = Common (-)

